

APX Double Door Enclosure – NEMA 4X

Specification Sheet

I. General

A. The purpose of this specification is to provide details of an enclosure that protects internal equipment from rain, dust, vandalism and other conditions found in an outdoor or otherwise harsh environment.

B. The manufacturer must be able, upon request, to produce part numbers on all components for repair purposes. Certificates of compliance may be requested on each cabinet or on any component or part thereof.

II. Performance

A. The enclosure(s) will meet or exceed the requirements of a NEMA 4X rating and will be UL Listed.

III. Cabinet Construction

A. General

1. The cabinet and doors will be constructed from 5052-H32 sheet aluminum alloy which has a thickness of 0.125". Alternate material is type 304 stainless steel, minimum thickness 14 gauge. Specifier must choose either aluminum or stainless steel construction. External welds will be made by using the Heliarc welding method; whereas, internal welds will be made by the wire welding method. All welds will be neatly formed and free of cracks, blow holes and other irregularities.

2. All inside and outside edges of the cabinet will be free of burrs.

3. The cabinet will be designed with a sloped top to prevent the accumulation of water on its top surface.

4. The door openings will be double flanged on all four (4) sides. Flanges increase strength around openings and keep dirt and liquids from entering the enclosure when the doors are open.

5. Door restraints will be provided to prevent door movement in windy conditions.

B. Door/Hardware

1. The door openings will be a minimum of 80% of the front surface area. Double doors will overlap and utilize a removable center post.

a) The doors will be furnished with a gasket that satisfies the physical properties as found in UL 508, and will form a weather-tight seal between the cabinet and door.

2. The hinges will be continuous and bolted to the cabinet and door utilizing $\frac{1}{4}$ -20 stainless steel carriage bolts and nylock nuts.

a) The hinges will be made of 0.075" thick stainless steel with a 0.25" stainless steel hinge pin.

b) The hinge pin will be capped top and bottom by weld to render it tamperproof.

c) Hinge leaves will not be exposed externally when the doors are closed, but hinge knuckles may protrude. All bolt holes will be gasketed.

3. The latching mechanism will be a 3-point draw roller type.

a) Pushrods will be turned edgewise at the outward supports and shall be 0.250" by 0.750" aluminum, minimum.

b) Rollers will have a minimum diameter of 0.875" and will be made of nylon. The center catch will be fabricated from 0.187" aluminum, minimum.

4. An operating handle will be furnished.

a) The handle will be stainless steel with a $\frac{3}{4}$ " diameter shank.

b) The latching handle will have a provision for padlocking in the closed position.

5. A light/alarm switch bracket will be provided.


IV. Equipment Mounting (Specify as Required)

A. Adjustable Channels

1. The enclosure will be equipped with two (2) adjustable "C" mounting channels on both side walls and back wall of the enclosure, allowing versatile positioning of shelves or panels.

Mounting Channel:

Length "A" varies by model.

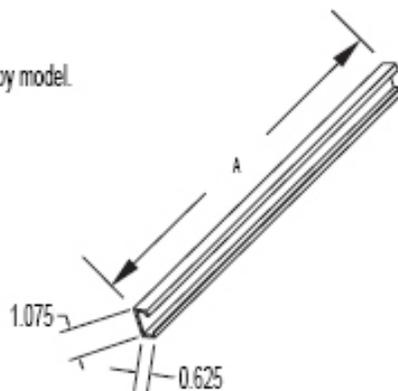

2. The channel assembly will provide infinite vertical and horizontal adjustment and not limit the positioning of shelves or panels. All mounting hardware will be furnished.

B. Shelves

1. If equipment is to be shelf mounted, the enclosure will be provided with shelves fabricated from 5052-H32 aluminum, having a thickness of 0.125".

2. The shelf depth will have a minimum of 10.50". The enclosure will have provision for positioning shelves or panels to within 4" of the bottom and to within 8" of the top of the enclosure.

C. Aluminum Back Panel

1. If equipment is to be panel mounted, the enclosure will be provided with 5052-H32 aluminum back panel having a thickness of 0.125". (NOTE: Cabinets wider than 48" will utilize two (2) panels side by side vertically.)

2. The panel will be natural finish. All mounting hardware will be furnished.

V. Cabinet Finish

A. Unless otherwise specified, the outside surface of the cabinet will have a smooth, uniform, natural aluminum finish.

B. If painted, the following steps will be taken as a minimum requirement:

1. The cabinet, doors and any other parts to be painted will be treated with an iron phosphate coating conversion technique.

2. After phosphatizing, the parts will be baked to eliminate any moisture in seams.

3. The finished coat of a polyester powder will be baked for ten (10) minutes for 400-450° F.

4. The finish will be commercially smooth, substantially free of flow lines, paint washout, streaks, blisters and other defects that would impair serviceability or detract from general appearance.


VI. Cabinet Mounting (Specify as Required)

A. Pole or Wall Mounted Enclosure


1. Enclosures intended for pole or wall mounting will be provided with stiffener plates with a thickness of 0.125" aluminum welded to the top and bottom of rear wall for added strength and rigidity. All mounting holes must be gasketed.

B. Pad Mounted Enclosure

1. Enclosures intended for pad mounting will be constructed with the following pattern:

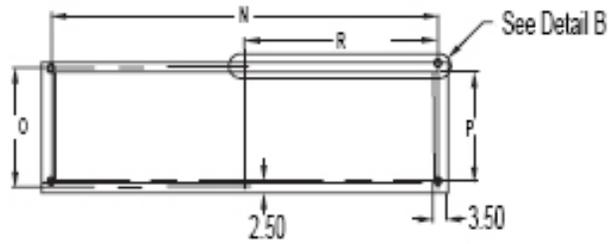

Pad Mounting Pattern

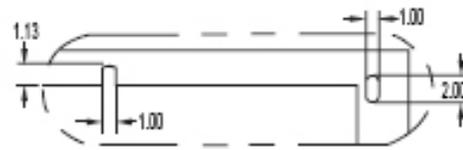

Detail B

VII. Approved Manufacturer

A. Cabinet is to be manufactured by APX Enclosures, Inc. or an approved UL Listed equivalent.

